



PLAN

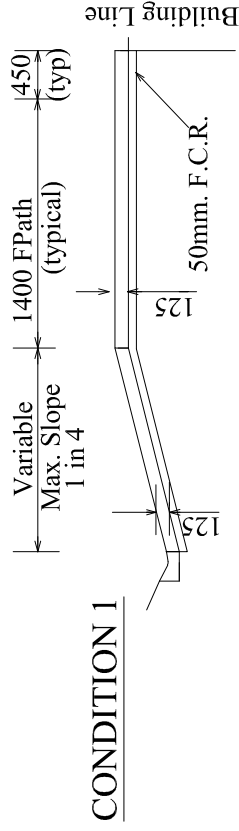

CONDITION 1

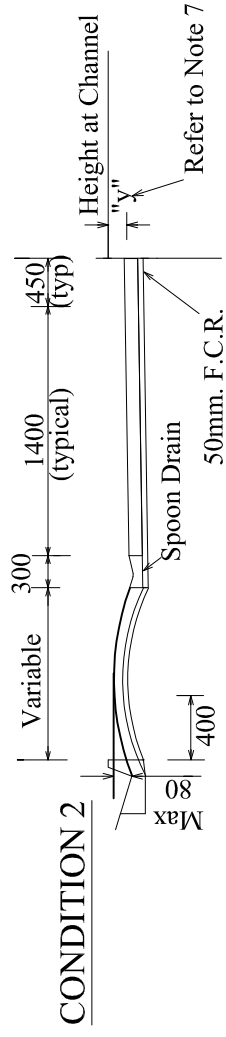

CONDITION 2

ELEVATIONS

NOTES

- EXISTING CROSSING TO BE EXCAVATED TO FIRM LEVEL BASE AS APPROVED BY COUNCIL SUPERVISOR. OVER EXCAVATION IS TO BE REINSTATED WITH APPROVED ROCK OR PACKING SAND TO FORM FIRM LEVEL BASE.
- FOOTPATH CROSSFALL TO MATCH EXISTING OTHERWISE NOMINAL 40MM. CONCRETE STRENGTH TO BE 28 MPA. AT 28 DAYS. CONCRETE TO HAVE 4% CHARCOAL COLOUR OXIDE ADDED AT
- ADDITIONAL JOINT PARALLEL TO KERB IS TO BE CONSTRUCTED WHERE DISTANCE FROM KERB TO FOOTPATH EXCEEDS 2.5M. OR AS DIRECTED BY COUNCIL SUPERVISOR
- THE MAX. WIDTH SHALL NOT BE ALTERED WITHOUT THE APPROVAL OF COUNCIL.
- FOR INDUSTRIAL AREAS USE 150MM TO 200MM THICKNESS CONCRETE
- CONDITION 2 OR "REVERSE FALL" AS SHOWN ABOVE TO BE INSTALLED WHERE HEIGHT AT BOUNDARY LINE NO MORE THAN 80mm HIGHER THAN CHANNEL AS DIRECTED BY COUNCIL SUPERVISOR