


100mm UPSTAND WITH
100mm GRATE/VENT



NOTES:

1. PIT/TRENCH TO BE BACKFILLED WITH 20mm OR 40mm AGGREGATE (SINGLE SIZE ROCK)
2. UPSTAND REQUIRED TO ALLOW SURCHARGING OF TRENCH
3. MINIMUM 1 UPSTAND PER 3m OF TRENCH. E.G. 5m TRENCH REQUIRES 2No. UPSTANDS WITH VENT
4. VOLUME OF TRENCH IN CUBIC METRES TO BE DETERMINED BY MULTIPLYING THE TOTAL SITE AREA (m²) x 0.0087
5. SHOULD THE SITE HARD-STAND COVERAGE EXCEED 60%; THE ABOVE RESULT WILL REQUIRE FACTORING IN CONSIDERATION OF THE ACTUAL COVERAGE
6. TRENCH TO BE [PLACED SUCH THAT THE BASE AND FINISHED SURFACE ARE LEVEL
7. SOAKAGE PIT MAY ONLY BE INSTALLED IF APPROVED BY COUNCIL

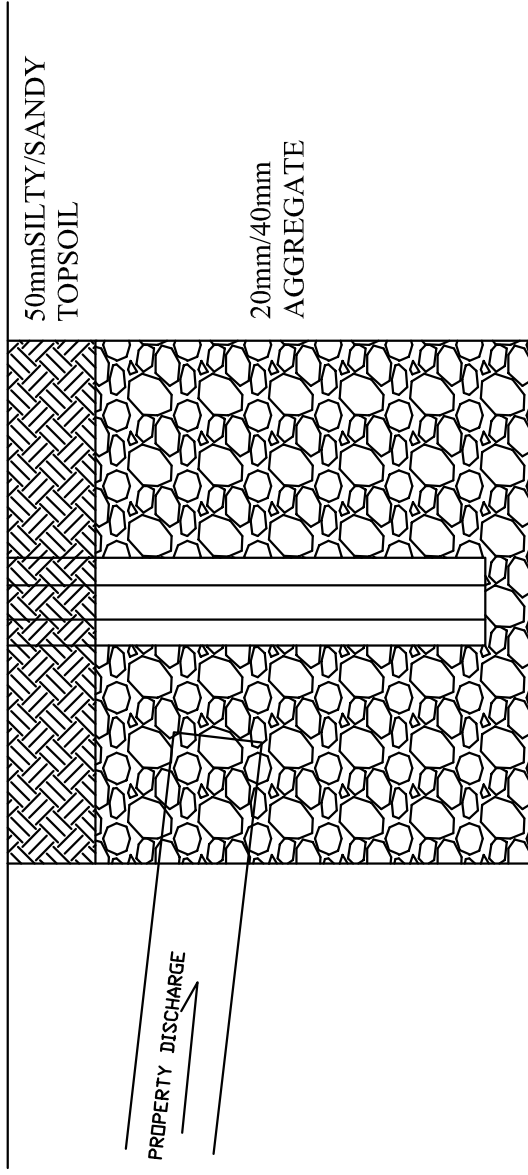

STORMWATER SOAKAGE PIT

STANDARD DRAWING

DATE REVIEWED

MAY 2022

SCALE

NTS

DRAWING No.

SD997