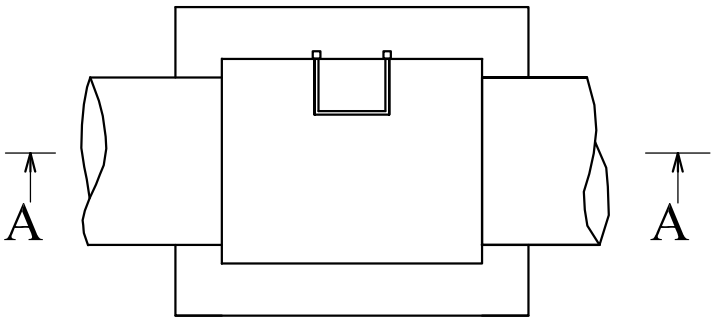


PLAN

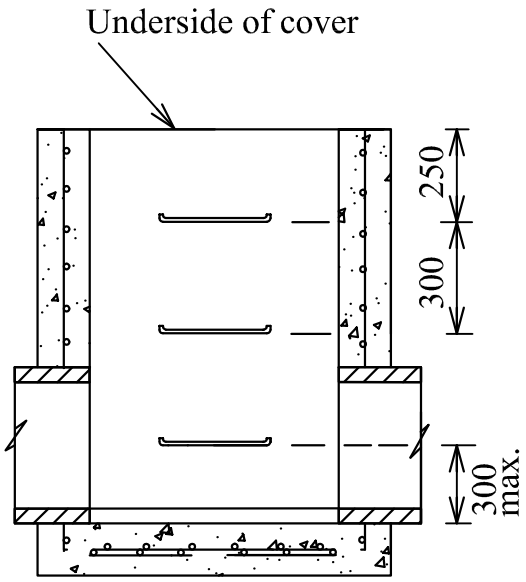


SECTION A-A

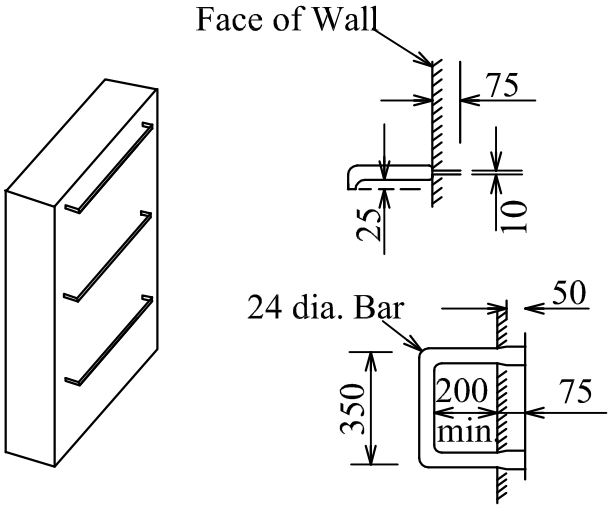


STEP IRON DETAILS

Gatic PS2-PF Polypropylene Steps (or approved

## NOTES

1. Pits deeper than 1000mm shall be fitted with step Irons.
2. Step Irons shall be located:
   - Directly below the opening in the cover.
   - Desirably on a wall without pipe openings.
   - Desirably on one of the long sides of the pit.
3. Steel for Step Irons shall be manufactured from steel AS 1204 Grade 250.
4. Step Irons shall have sharp edges rounded and shall be prepared and Hot Dipped Galvanised in accordance with requirements of AS1650.
5. Proprietory steps are to be installed in accordance with the manufacturers instructions.
6. For Precast Pits, Step Irons shall be load tested to AS4198/1994.
7. All dimensions are in millimeters

BOROONDARA
City of Harmony

# STEP IRONS

STANDARD DRAWING

DATE REVIEWED
OCTOBER 2015

SCALE
NTS

DRAWING NO.
SD1001